LEGEND

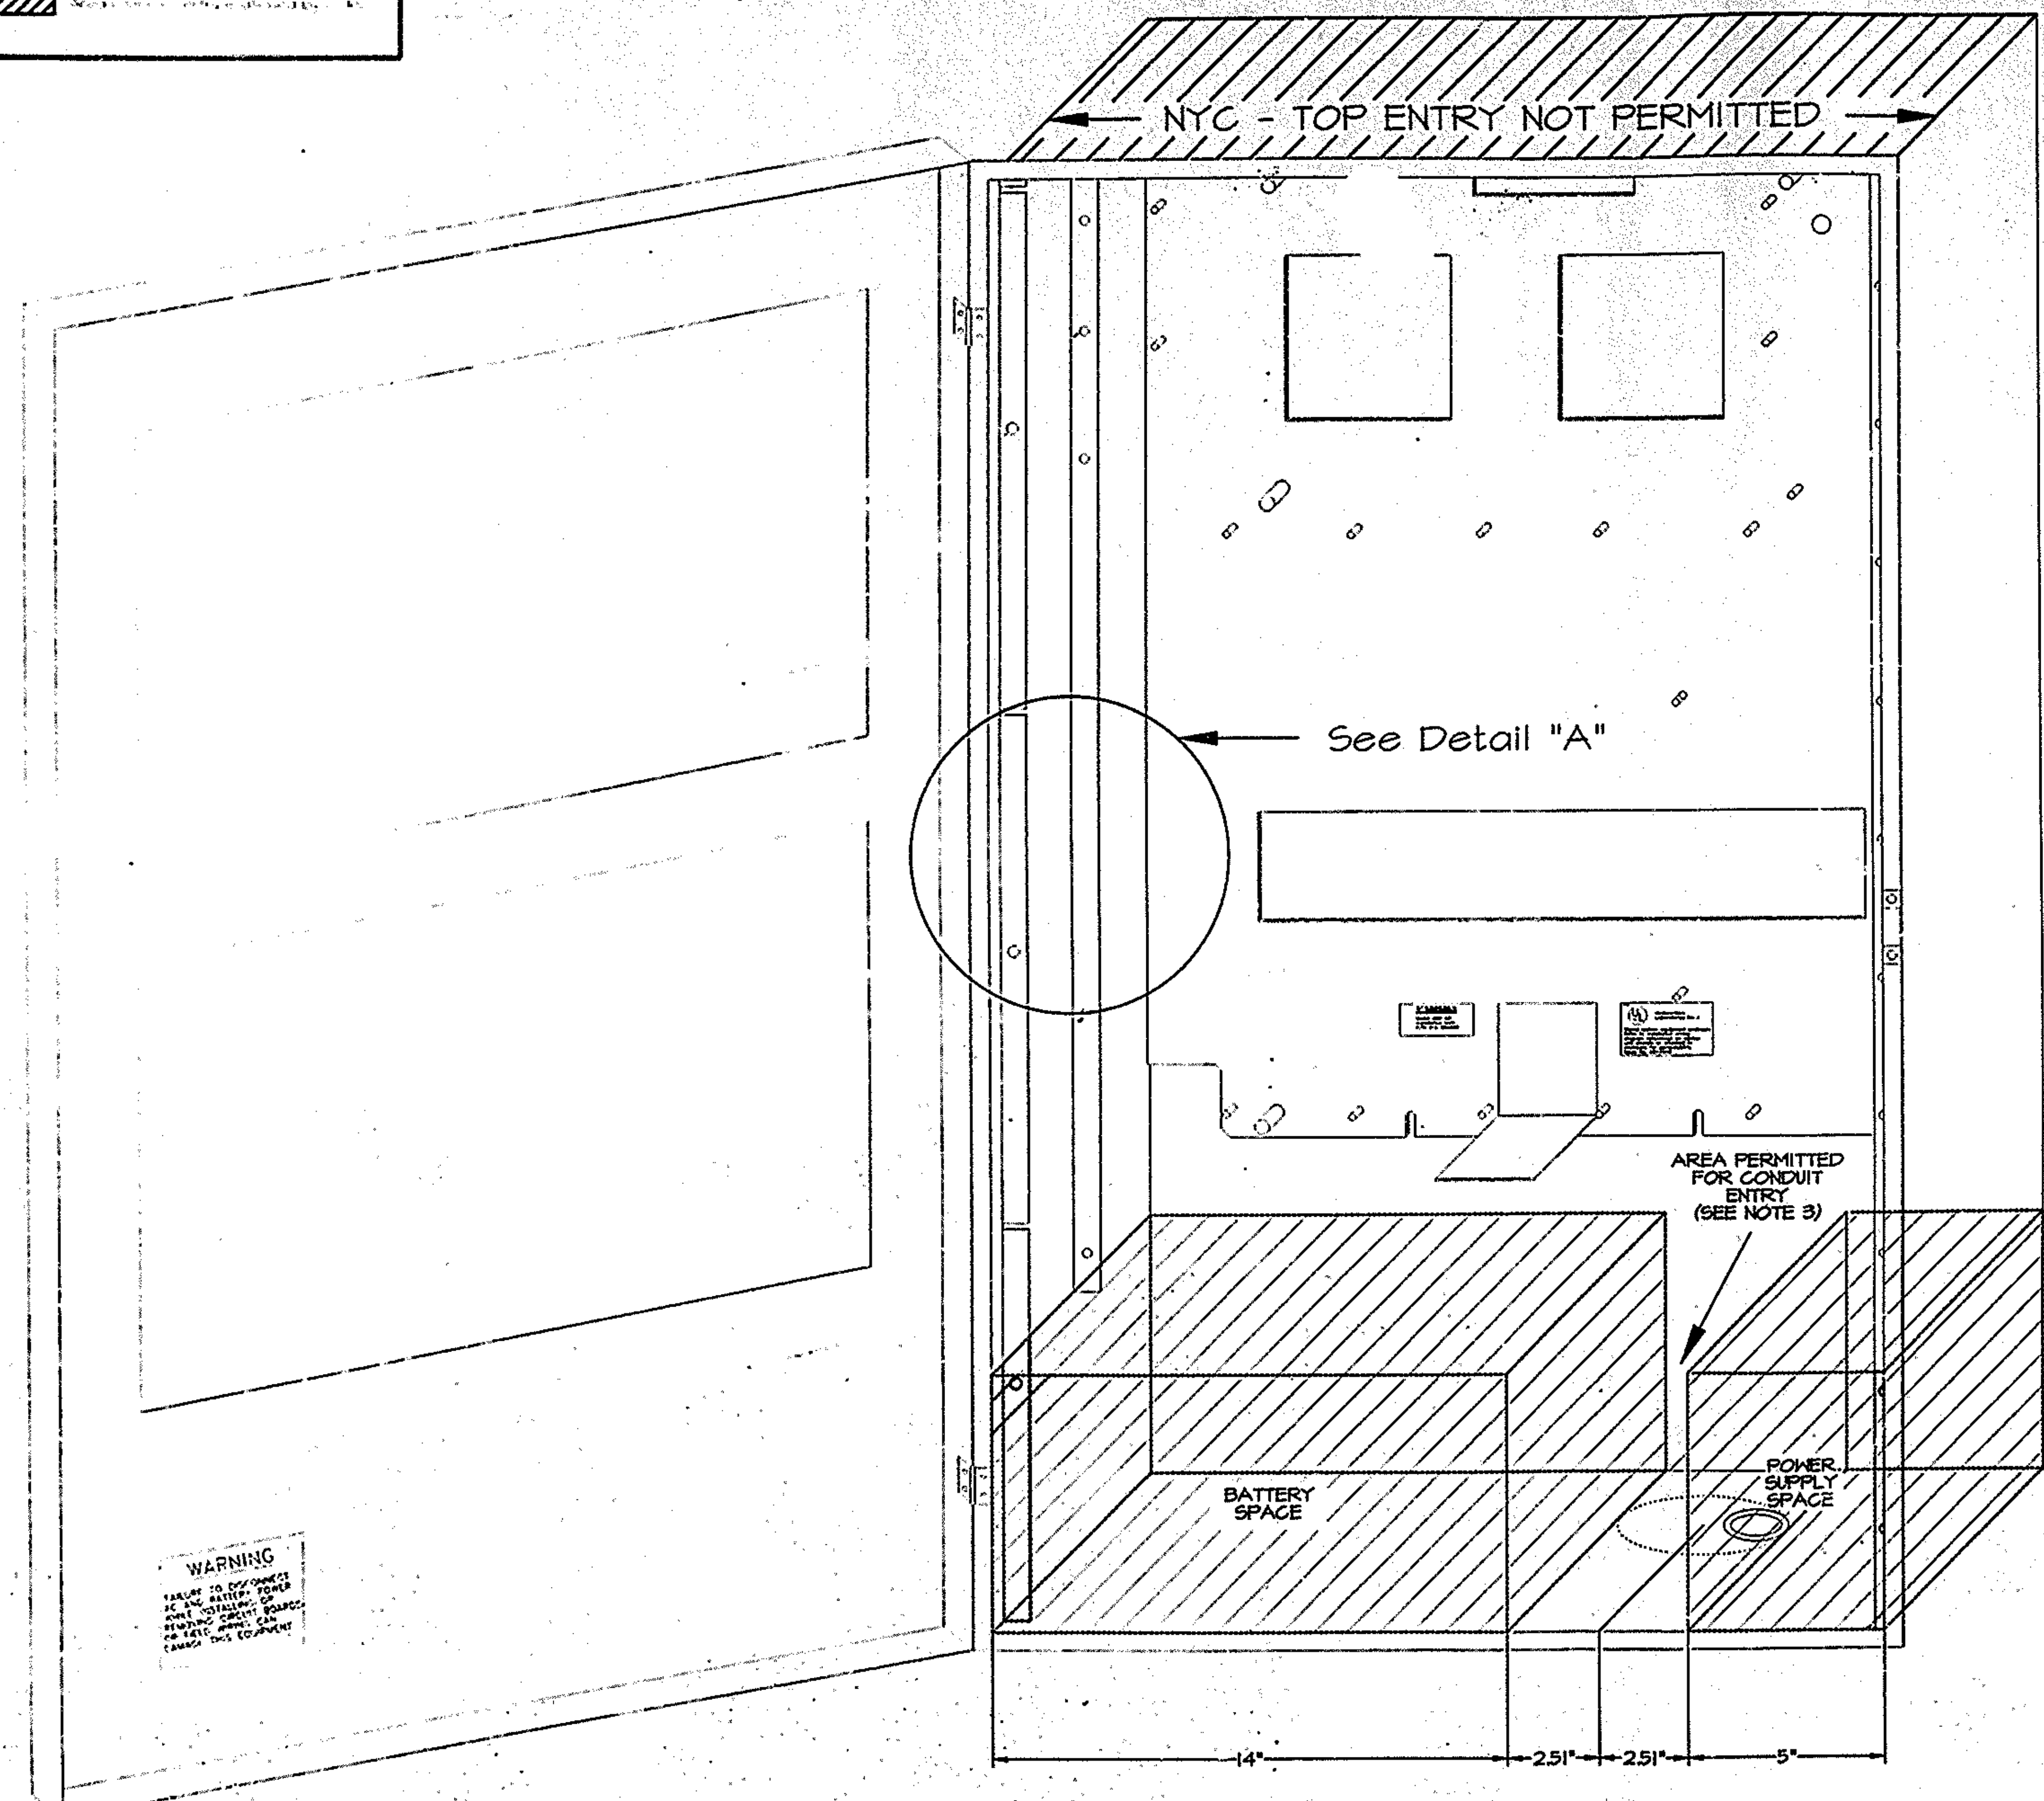

MME-3 BACKBOX WITH MBR-MP BACKPLATE

N.T.S

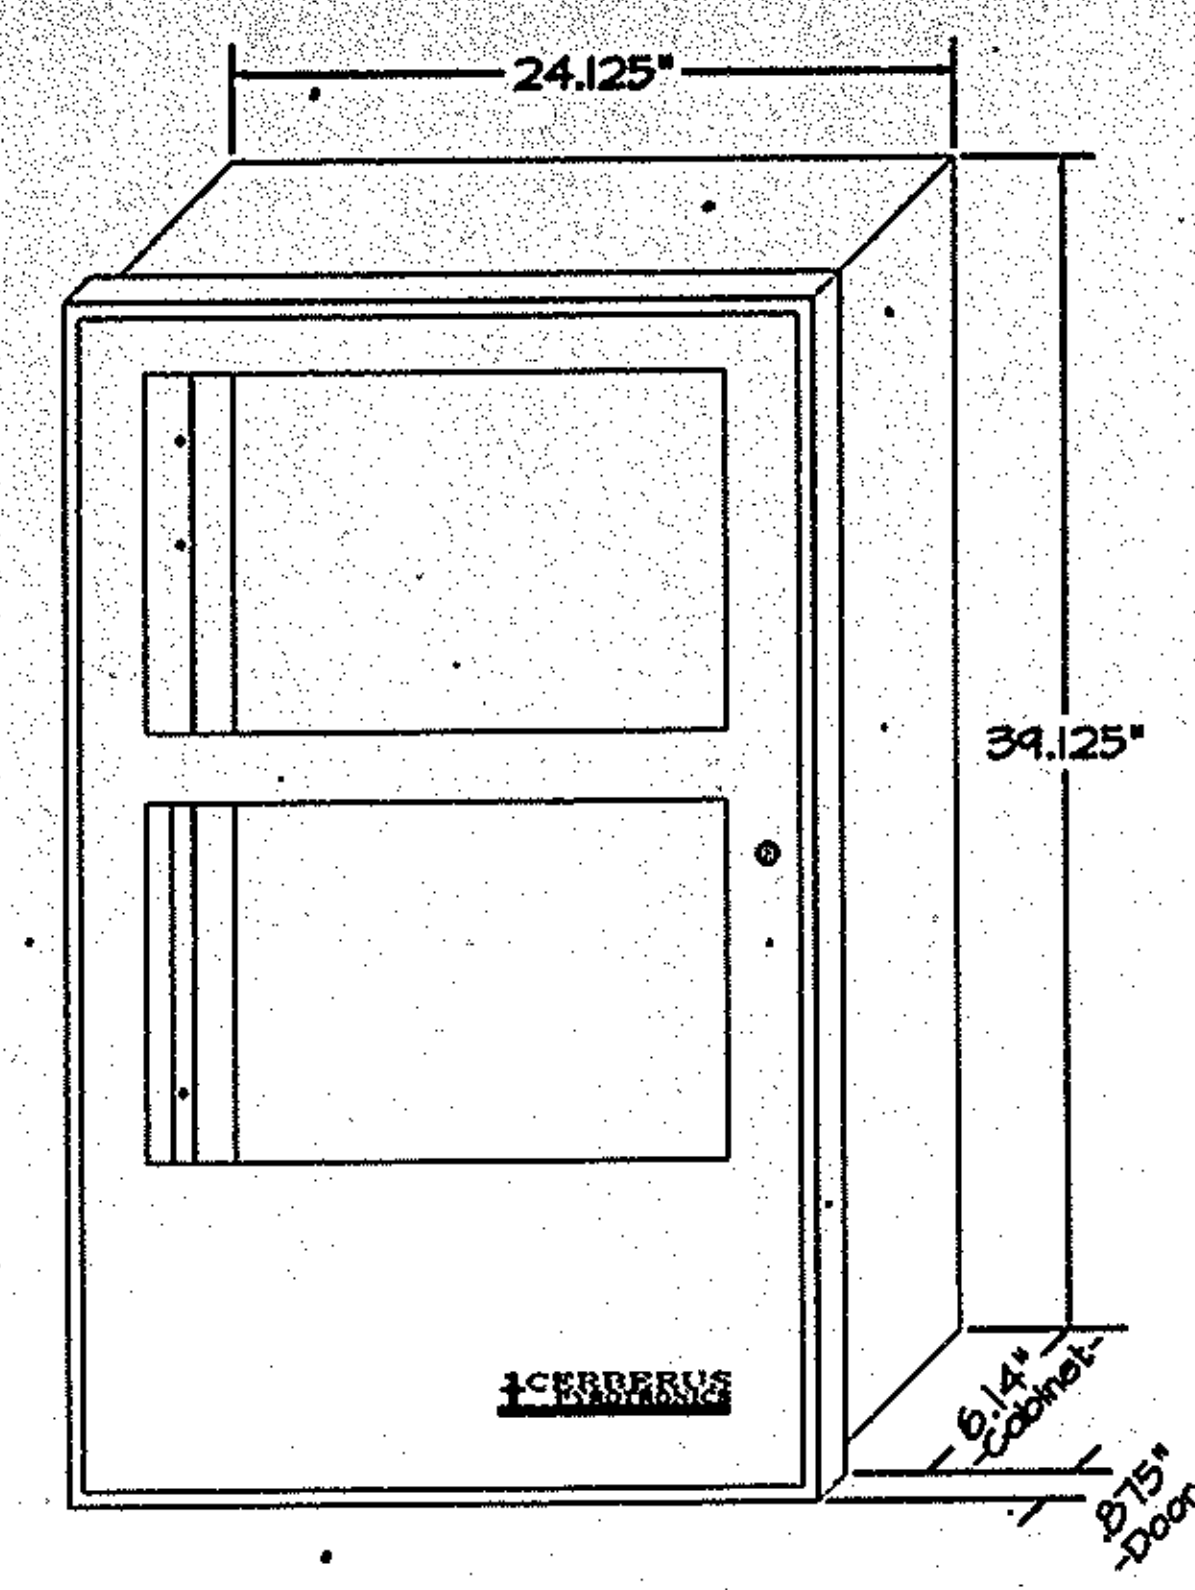

MME-3 Dimensions

N.T.S

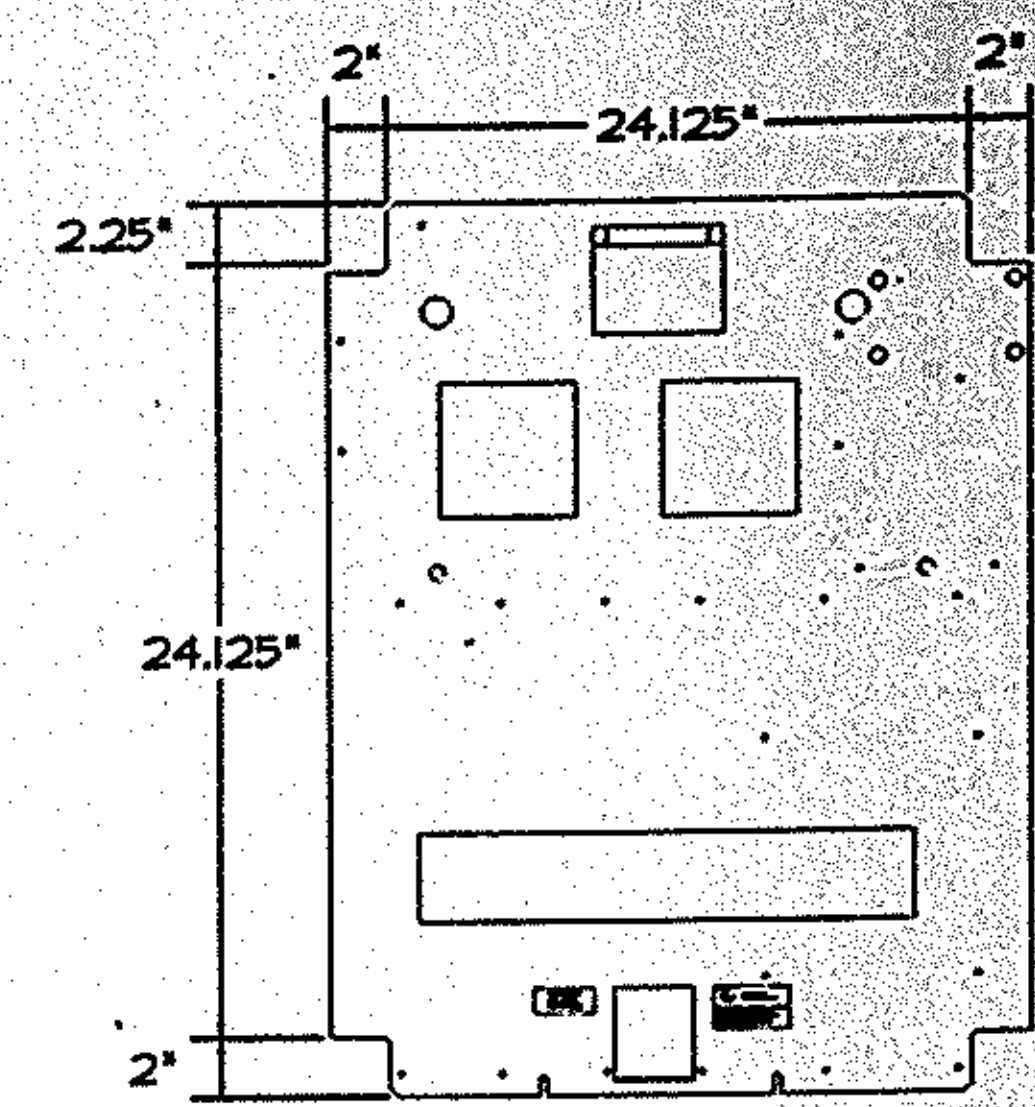

MBR-MP Dimensions

N.T.S

(Outside Dimensions)

DETAIL "A"

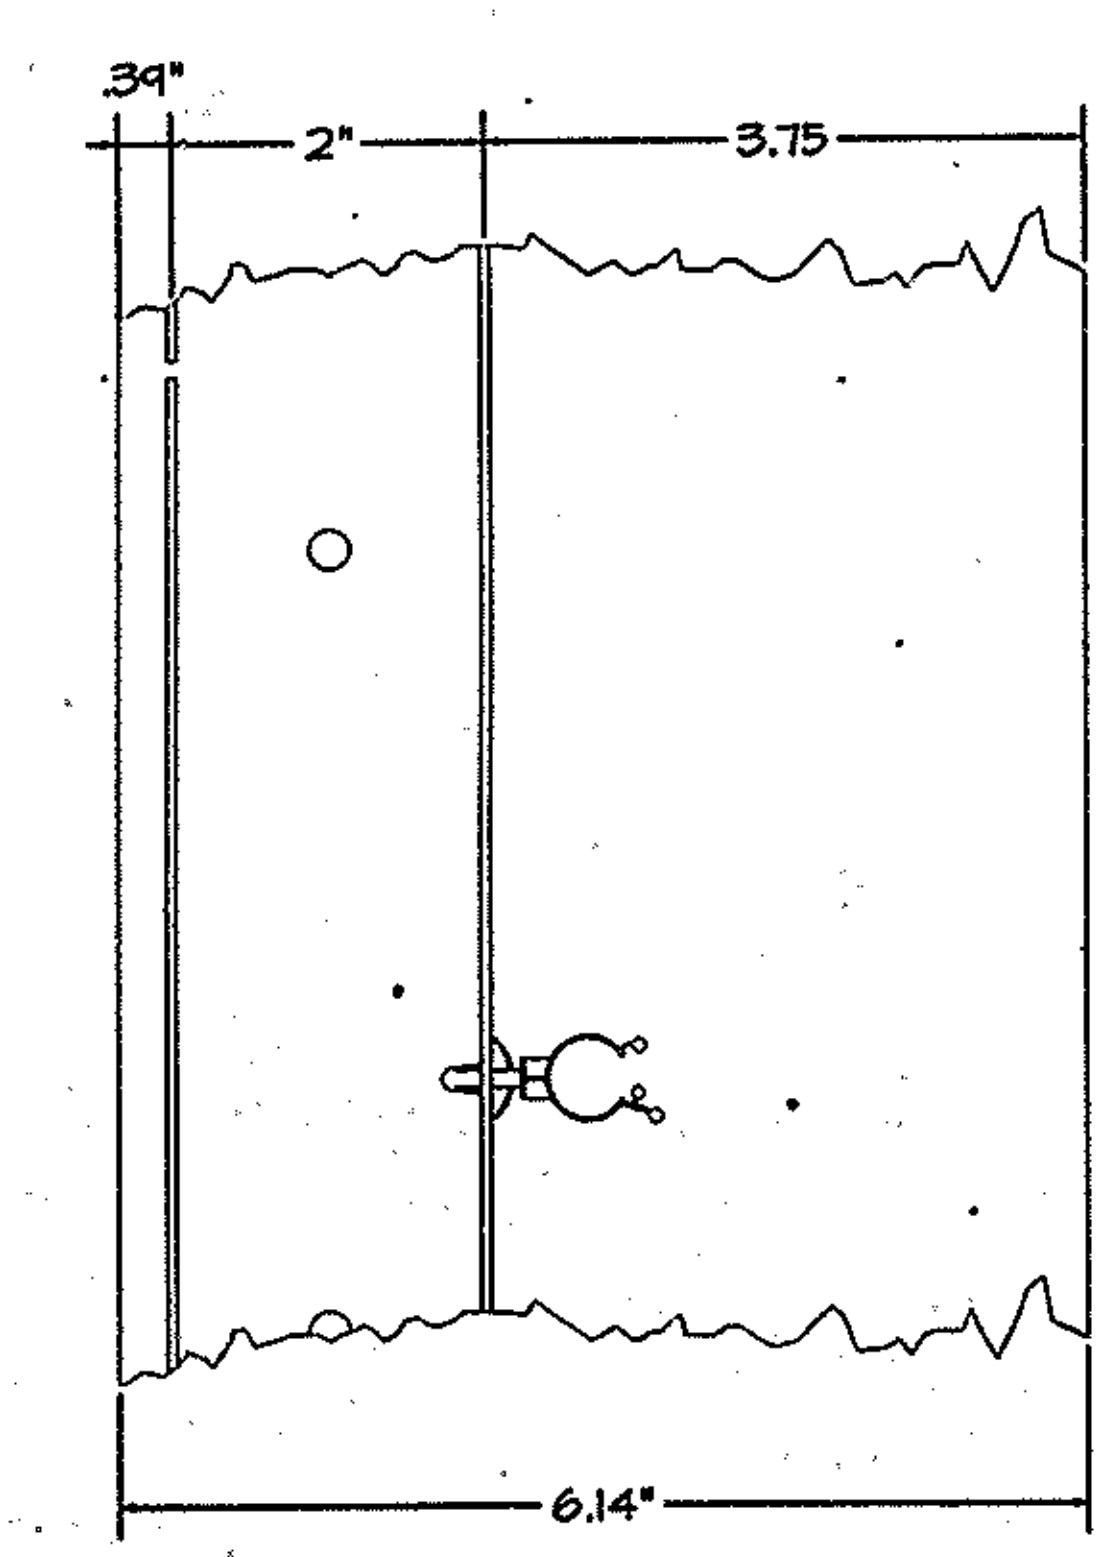

(Inside Dimensions)

DETAIL "B"
MME-3 Mounting Dimensions

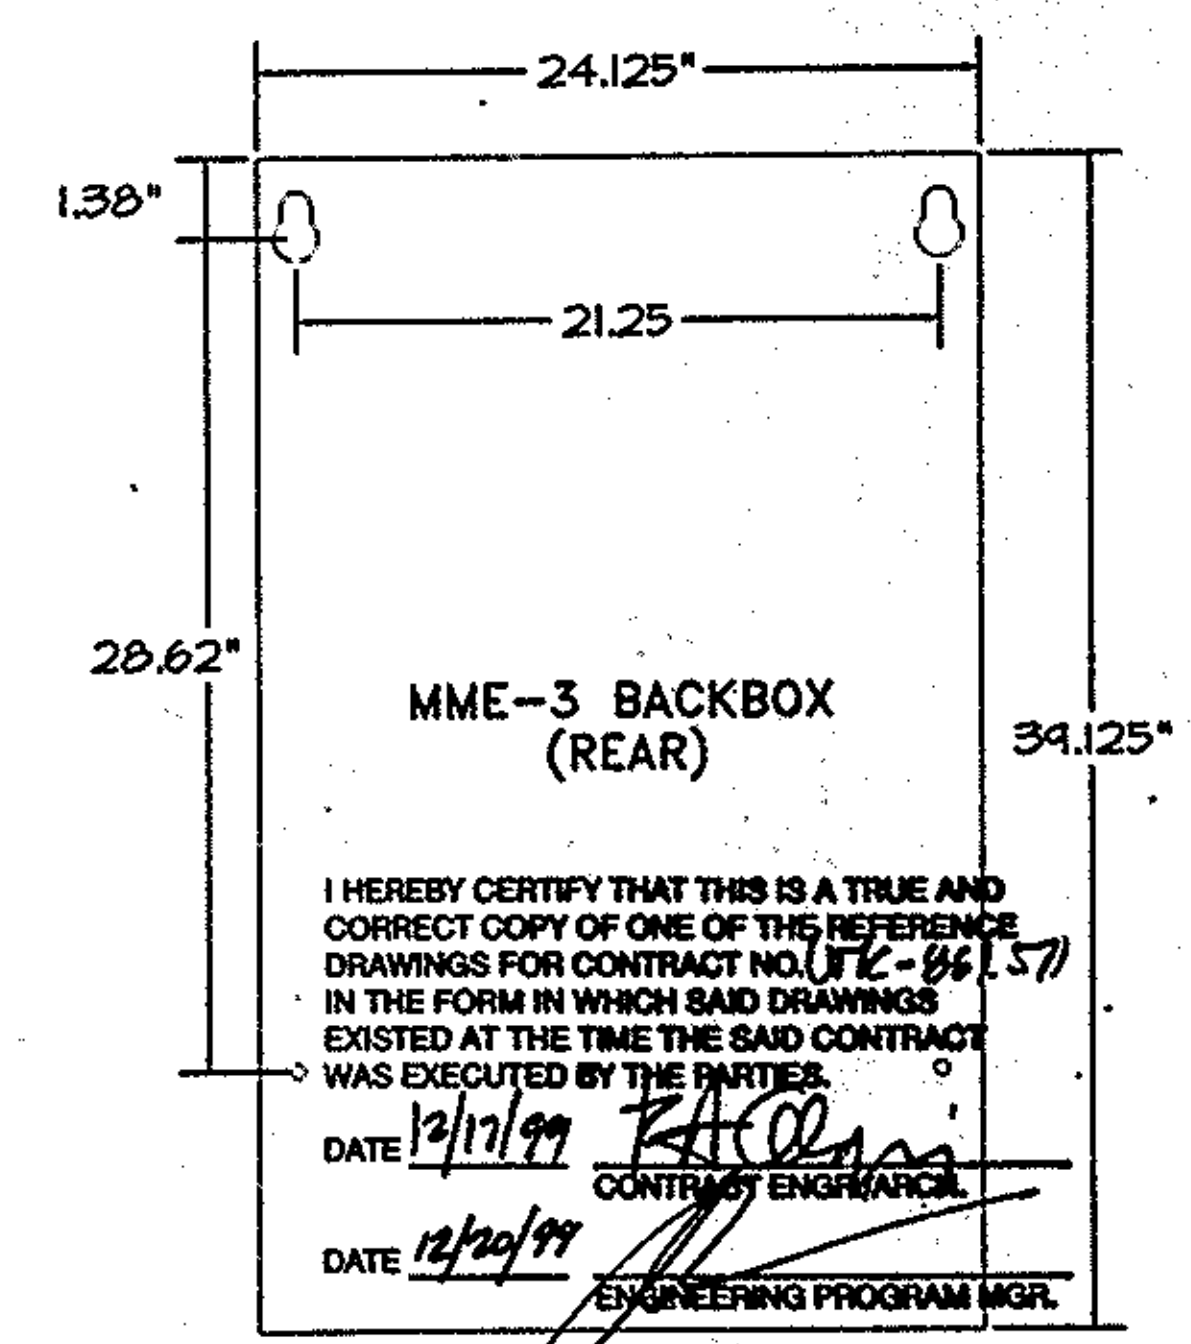

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE REFERENCE DRAWINGS FOR CONTRACT NO. C-86157[illegible] IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 12/17/99 [signature] CONTRACT ENGINEER

DATE 12/20/99 [signature] ENGINEERING PROGRAM MGR.

(Outside Dimensions)

REVISIONS

REV.	DESCRIPTION	CHK DATE	APP'D DATE
# 2	ISSUED FOR CONSTRUCTION	5/17/99	5/17/99
# 1	ISSUED FOR PA REVIEW	5/4/99	5/4/99
# 0	CREATED DRAWING	5/1/99	5/1/99

NOTES

1) SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH SIEMENS-CERBERUS DIVISION SPECIFICATIONS, APPLICABLE CODES & THE CONTRACT DOCUMENTS. DISCREPANCIES, CONFLICTS AND OMISSIONS FOUND ON ANY DOCUMENT, DRAWING, SKETCH, ETC. SHALL BE REPORTED IMMEDIATELY TO THE SIEMENS-CERBERUS DIVISION PROJECT MANAGER. INSTALLING CONTRACTOR SHALL NOT PROCEED UNTIL CLARIFICATION AND RESOLUTION IS ISSUED IN WRITING BY SIEMENS-CERBERUS DIVISION PROJECT MANAGER. ALL WORK SHALL BE FULLY INSPECTED AND TESTED BY A CERTIFIED SYSTEMS TECHNICIAN DESIGNATED BY THE SIEMENS-CERBERUS DIVISION PROJECT MANAGER. SYSTEMS SHALL NOT BE POWERED UP PRIOR TO THIS POINT.

2) ALL CONNECTIONS MADE DIRECTLY OR INDIRECTLY TO SIEMENS-CERBERUS DIVISION EQUIPMENT AND SYSTEMS SHALL BE IN ACCORDANCE WITH ALL [illegible] DRAWINGS, [illegible] EQUIPMENT, METHODS OR MATERIALS NOT [illegible] APPROVED FOR USE WITH THIS EQUIPMENT BY SIEMENS-CERBERUS DIVISION SHALL NOT BE EMPLOYED.

3) WHEN INSTALLING A CONDUIT LARGER THAN THE [illegible] PROVIDED IN THIS AREA ENLARGE [illegible] TOWARDS BATTERY SPACE TO AVOID INTERFERING WITH THE POWER SUPPLY.

FIRE ALARM SYSTEM
DEVICE UPGRADE
PHASE III

SIEMENS Cerberus Division

Siemens Building Technologies, Inc.

DWN: NP	MXLRV Transponder MME-3 Cabinet Mechanical Specifications
CHK: JD	
APP'D: JD	
Date: 5/1/99	
SCALE: NONE	
ACF 861 571	
SHEET 4 OF 4	NTS SPECIFICATIONS